


All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Eco-10 type.

E.E. to confirm all circuiting requirements.

Architect to verify quantity, location & finish of all controls.

All faceplates, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA T*.

Lutron Field Service commissioning included in all systems initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

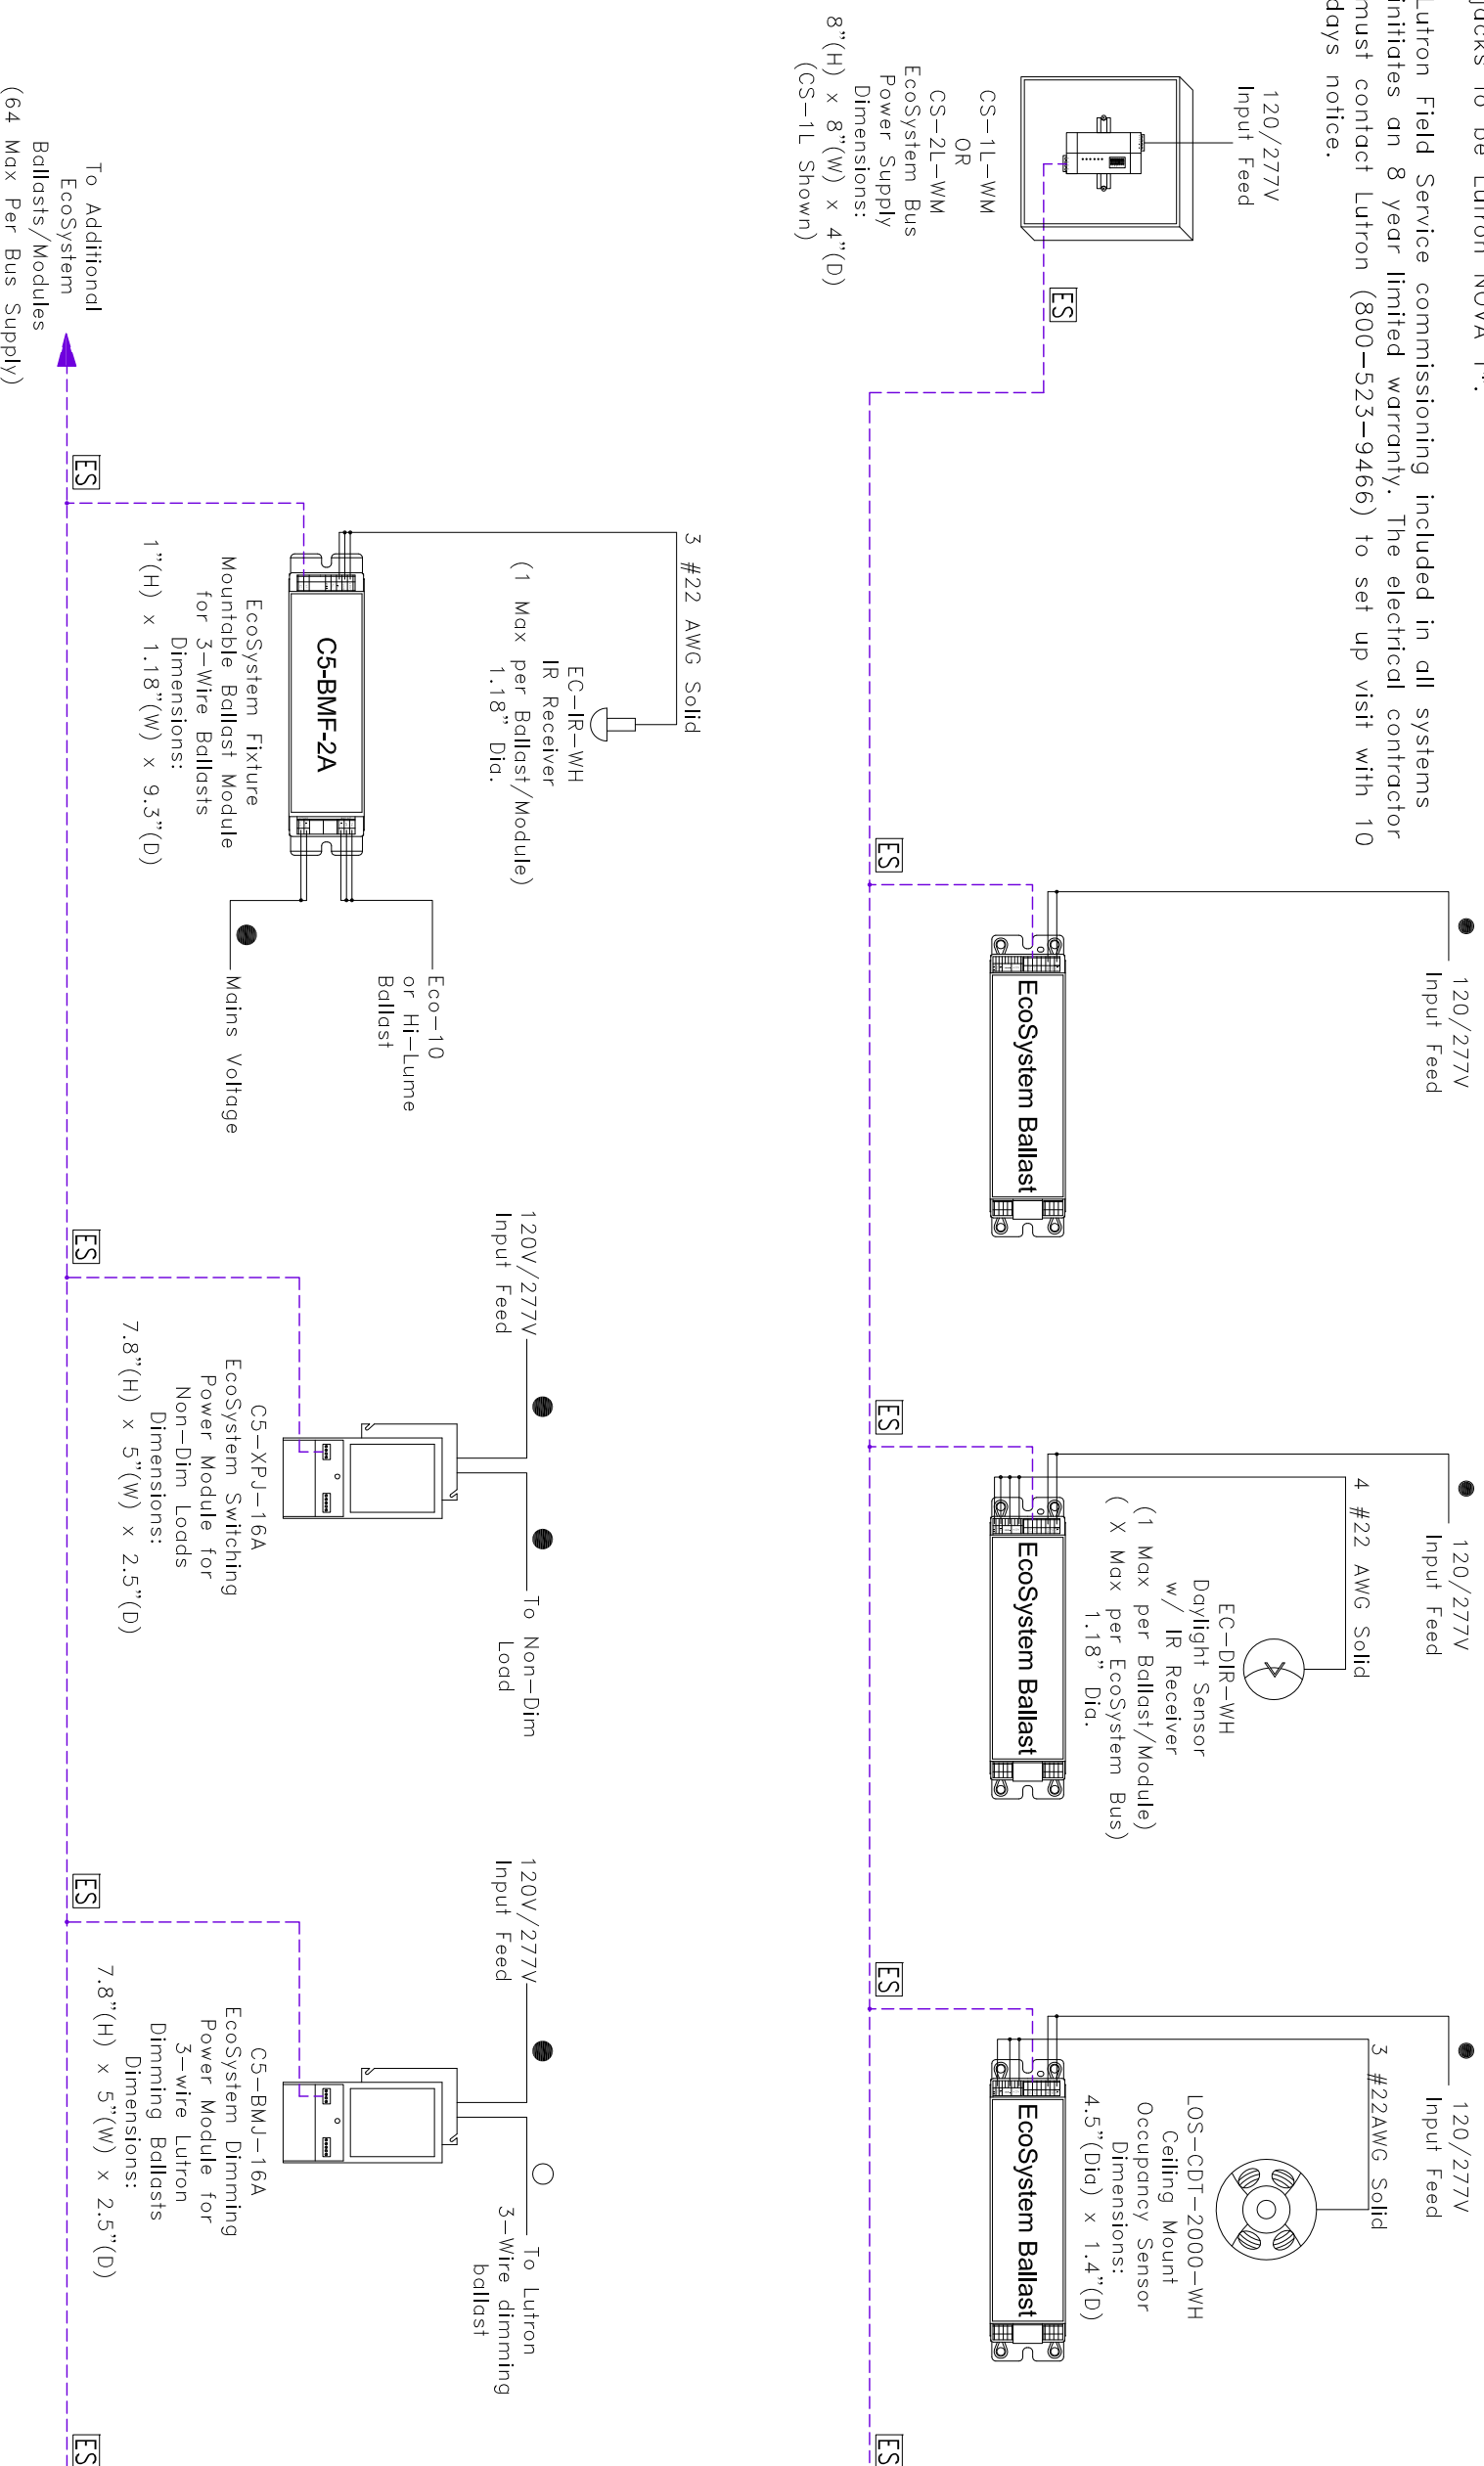

WIRING NOTES:

- 2 #12AWG (2.5 mm²)
 - 3 #12AWG (2.5 mm²)
 - 120V Input Power
- ES** EcoSystem link requires Lutron cable C-CBL-216-GR-1 (2 #16 Conductor Non-Plenum) or C-PCBL-216-CL-1 (2 #16 Conductor Plenum rated) Otherwise use 2 #16AWG by others.

EcoSystem Typical

**ONLINE DIAGRAM
CONCEPT ONLY
NOT FOR CONSTRUCTION**

Project Number:	X
Drawn By:	X
Drawing Revision:	X
Drawing Date:	X
Sheet:	X