


All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Eco-10 type.
 E.T. to confirm all circuiting requirements.
 Architect to verify quantity, location & finish of all controls.
 All receptacles, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA™.
 Lutron Field Service commissioning included in all systems. Initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

(Shades and Shade Power Panels to be provided by Window Treatment Dealer)

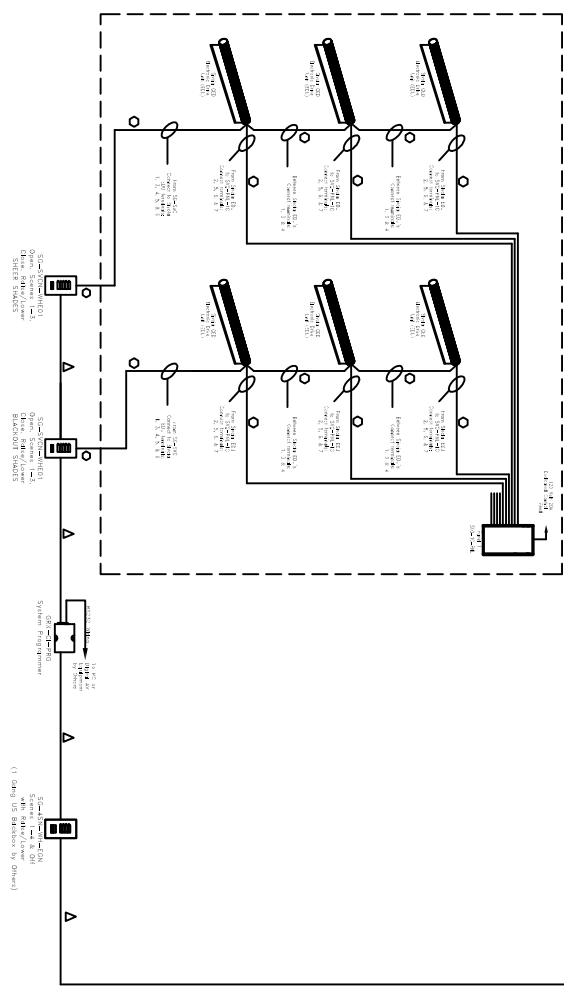

WINNINGSYMBOLS

- ▲ Lutron cable GRV-CBL-46L (5 Conductor Non-Plenum) or GRV-FCEL-46L (5 Conductor Plenum rated). Otherwise use E-#12AWG (250mV), 1 E-#14AWG (200mV) or E-#16AWG (150mV) for emergency signaling.
- Shade link requires Lutron cable SV0-CBL-250 or 2 #16(Flower), 1 #18 (Std) plus 4 #18 Twisted and Shielded.

**CONCEPT DRAWING
NOT FOR CONSTRUCTION**

**GRAFIK Eye 4000
System**

Project Number:	X
Drawn By:	X
Drawing Revision:	X
Drawing Date:	X
Sheet:	X

LUTRON.
 Lutron Electronics Co., Inc.
 2700 State Road (Crossing 74) Room 100A
 7705 Westchase Lane, Houston, TX 77057